

**INSTITUTO DE CIENCIAS
DE LA CONSTRUCCIÓN
EDUARDO TORROJA**

C/ Serrano Galvache 4. 28033 Madrid (Spain)
Tel: (+34) 91 302 0440.
direccion.ietcc@csic.es. <https://dit.ietcc.csic.es>

European Technical Assessment

**ETA 19 / 0654
of 04/08/2021**

English translation prepared by IETcc. Original version in Spanish language

General Part

Technical Assessment Body issuing the ETA:

Instituto de Ciencias de la Construcción Eduardo Torroja (IETcc).

Trade name of the construction product:

ALBOND SC.

Product family to which the construction product belongs:

Kits for external wall claddings mechanically fixed.

Manufacturer:

ALBOND ALÜMINYUM SANAYI VE TIC. A.S.
Hatip Mahallesi Ali Osman Çelebi Bulvar N. 140.
59860 Çorlu (Turkey).
www.albond.com.tr

Manufacturing plant(s):

ALBOND ALÜMINYUM SANAYI VE TIC. A.S.
Hatip Mahallesi Ali Osman Çelebi Bulvar N. 140.
59860 Çorlu (Turkey).

This European Technical Assessment contains:

14 pages, including 3 Annexes, which form an integral part of the assessment. Annex C contains confidential information and is not included in the ETA when is publicly available.

This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of:

European Assessment Document (EAD)
090062-00-0404. Ed. July 2018. Kits for external wall claddings mechanically fixed.

This version replaces:

ETA 19/0654 version 1 issued on the 26/02/2021

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted Annex(es) referred to as confidential(s)). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

SPECIFIC PARTS

1. Technical description of the product (kit)

The assessed kit for ventilated external wall cladding mechanically fixed named “albond SC” (family G) ⁽¹⁾ is based on thin metallic composite panels “albond® PE” and “albond® FR” which are manufactured by the ETA-holder. This cladding material is mechanically fastened to a subframe, fixed to the external walls of new or existing buildings (retrofit). An insulation layer can be fixed on the external wall. The kit comprise other components as specified in Table 0, which are factory produced by the ETA – holder or by suppliers.

| Table 0 – Definition of components of the kit | | | | |
|---|--|----------------|---|--|
| Component | | Reference | Material | Size (mm) [Tolerances] |
| Subframe elements | Vertical profile | Ref.02.01.004 | Ω-shape section vertical profiles made of raw finished extruded alloyed aluminium 6063 T5/T6. | Length: ≥ 6000 Thickness: 2.5 |
| | Brackets | Ref.02.01.001 | U-shape (single) bracket made of raw finished extruded alloyed aluminium 6063 T5. | Thickness: 3 |
| Cladding | Suspended cassettes (family G) | Serie 9000 | Cassettes type size “A” with lateral simple folded flanges ≥ 45 mm depth, top horizontal folded flange, and bottom horizontal simple folded flange, with two slots distanced ≤ 500 mm each other, tongue width 15 mm on each vertical flange, made from albond® PE or albond® FR, described below. Blind rivets alu/alu 12 mm are used for mounting the cassette. | Length: ≤ 900 Height: ≤ 665 |
| | | | Cassettes type size “B” with lateral simple folded flanges ≥ 45 mm depth, top horizontal folded flange, and bottom horizontal simple folded flange, with three slots distanced ≤ 500 mm each other, tongue width 15 mm on each vertical flange, made from albond® PE or albond® FR, described below. Blind rivets alu/alu 12 mm are used for mounting the cassette. | Length: ≤ 900 Height: ≤ 1165 |
| | | | Cassettes type size “C” with lateral simple folded flanges ≥ 45 mm depth, top horizontal folded flange, and bottom horizontal simple folded flange, with five slots distanced ≤ 490 mm each other, tongue width 15 mm on each vertical flange, made from albond® PE or albond® FR, described below. Blind rivets alu/alu 12 mm are used for mounting the cassette. | Length: ≤ 900 Height: ≤ 2165 |
| | | | <u>albond® PE</u> : Composed by two external alloyed aluminium sheets EN AW 3105 H44/H46 or 5005 H44/H46, and an internal core made of recycled low density polyethylene (LDPE). <u>albond® FR</u> : Composed by two external alloyed aluminium sheets EN AW 3105 H44/H46 or 5005 H44/H46, and an internal core made of recycled low density polyethylene (LDPE) plus mineral compounds. | Standard width: 1000,1250,1500 Max. width:1600 Tol: [0.0, +0.2] Standard thickness: 4 Tolerances: Tol: [± 0.2] |
| Fixings | Elements used to fix cladding and/or subframe elements | Ref. 02.01.003 | Hanger piece made of alloyed aluminium EN AW 6060 or 6063 T5 extruded and raw finished profile plus elastomeric protective piece foreseen to be screwed to vertical profiles by self-drilling and self-tapping screws EN ISO 15480 or 15481 (also known as DIN 7504 N or K) ST 4.5 x 19 mm A2/50 stainless steel A2 | -- |
| | | Ref. 01.01.006 | Self-screwing screw made of stainless steel A2: Hexagon washer head drilling screws with tapping screw thread EN ISO 15480 (also known as DIN 7504 K) plus complementary EPDM washer if needed (5,5 x 19). | -- |
| Accessories | Neoprene Temas | -- | Polymeric clip for interlocking hanger piece on slots of cassettes. | -- |

¹ Families described at Table 1.1 of EAD 090062-00-0404 (hereafter EAD) ed. July 2018.

2. Specification of the intended use in accordance with the applicable European Assessment Document (hereinafter EAD)

2.1. Intended use

The kit is intended to be used for ventilated external wall claddings which can be fixed to the external walls of new or existing buildings. The assessed kit is a non-load-bearing construction system, and therefore, it does not contribute to the stability of the wall on which is installed, neither to ensure the air tightness of the building structure. But it can contribute to durability of the works by providing enhanced protection from the effect of weathering.

2.2 Relevant general conditions for the use of the kit

The provisions made in this European Technical Assessment are based on an assumed working life of 25 years as minimum according to the EAD, provided that the conditions lay down for the installation, packaging, transport and storage as well as appropriate use, maintenance and repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a mean for choosing the right product in relation to the expected economically reasonable working life of the works.

2.3 Design of the kit in works

The design of external wall cladding for ventilated façade using the kit should consider:

- The mechanical characteristic values of the components (e.g. panels, cladding fixings and subframe) in order to resist the actions applying on the specific work.
- The substrate material to define the suitable anchorages.
- The possible movements of substrate and the position of the building expansion joints.
- The dilatation of components of the kit and of the panels.
- The category of corrosivity of the atmosphere of the works ⁽²⁾.
- Because joints are not watertight, the first layer behind ventilated air space must be composed by materials with low water absorption.
- The construction of singular parts of façade (e.g. base, top, corners, windows, etc.).
- If the entire building must comply with the specific building regulations, particularly concerning fire and wind load resistance, of the Member States in which the work has been built.

2.4 Installation of the kit in works

Installation should be carried out according to the ETA holder's specifications and using the specific components of the kit, manufactured by the ETA holder or by suppliers recognized by the ETA holder. Installation should be carried out by appropriately qualified staff and under the supervision of the technical responsible of the site.

2.5 Use, maintenance and repair of the works

Maintenance of the assembled system or components of the kit includes inspections on site, taking into account the following aspects:

- Regarding the panels: Appearance of any damage such as cracking, delamination or detachment due to permanent and irreversible deformation.
- Regarding metallic components: Presence of corrosion or water accumulation.
- Necessary repairs should be done rapidly, using the same kit components and following the repair instructions given by ETA holder.

² E.g. See Table 1 of Standard EN ISO 12944-2:2017. Paints and varnishes. Corrosion protection of steel structures by protective paint systems. Part 2: Classification of environments.

3. Performance of the product and references to the methods used for its assessment

The assessment of the kit for ventilated external wall claddings according to the Basic Work Requirements (BWR) was carried out in compliance with the EAD 090062-00-0404. Characteristics of the components shall correspond to respective values laid down in the technical documentation of this ETA, checked by IETcc.

• **Basic Work Requirement 2: Safety in case of fire**

1. Reaction to fire:

Kit has been assessed ⁽³⁾ according to cl. 2.2.1 of EAD, as described below:

Kit ALBOND SC, based on:

- albond[®] PE: No performance assessed.
- albond[®] FR: B-s1,d0. (Classification/Tests report RA19-0033 issued by CSTB).

These classifications referred to Standard EN 13501-1 ⁽⁴⁾ and have been obtained from tests results carried out according to Standards EN ISO 11925-2 ⁽⁵⁾ and EN 13823 ⁽⁶⁾.

2. Façade fire performance of kits clad with TMCP albond[®] PE / albond[®] FR:

No performance assessed.

3. Propensity to undergo continuous smouldering:

No performance assessed.

• **Basic Work Requirement 3: Hygiene, health and the environment**

4. Watertightness of joints (protection against driving rain):

Purposeless for claddings kit with open joints. Kit is not watertight according to cl. 2.2.4 of EAD.

5. Water absorption of cladding:

No performance assessed. Not relevant for ventilated façades according to cl. 2.2.5 of EAD.

6. Water permeability and water vapour permeability:

No performance assessed, as it is not relevant for ventilated façades according to cl. 2.2.6 of EAD.

7. Drainability:

According to cl. 2.2.7 of EAD, on the basis of the standard construction details the installation criteria of the kit and the technical knowledge and experience, it may be said the water which penetrates through joints into the air space or the condensation water can be drained out from the cladding without accumulation or moisture damage into the substrate.

8. Content, emission and/or release of dangerous substances:

No performance assessed.

³ A European reference fire scenario has not been laid down for facades. In some Member States, the classification of the cladding kit according to Standard EN 13501-1 might not be sufficient for the use in façades. An additional assessment of the kit according to the national provision (e.g. on the basis of a large scale test) might be necessary to comply with Member State Regulations, until the existing European classification system has been completed.

⁴ EN 13501-1:2007+A1:2010 Fire classification of construction products and building elements - Part 1: Classification using data from reaction to fire tests.

⁵ EN ISO 11925-2:2011. Reaction to fire tests - Ignitability of products subjected to direct impingement of flame - Part 2: Single-flame source test.

⁶ EN 13823:2012. Reaction to fire tests for building products - Building products excluding floorings exposed to the thermal attack by a single burning item.

• **Basic Work Requirement 4: Safety and accessibility in use**

9. Wind load resistance:

The behaviour of the kit exposed to wind pressure is most favourable than when exposed to wind suction. Therefore, wind pressure test has been avoided and wind pressure resistance of kit can be considered as equal to wind suction resistance. It has been determined by tests carried out according to cl. 2.2.9 of EAD, on rigs of the cladding kit based on albond® PE/ FR. A summary of test results is indicated in the Table 1:

| Rig | Suspended cassettes type size A (L: Length. H: Height) | Suction (Pa) ⁽⁷⁾ | Type of failure ⁽⁸⁾ | Maximum Deflection ⁽⁹⁾ (mm) | | | |
|---------------------------------|---|---|---|--|----------------------------------|-------|-------|
| | | | | Permanent d _p | Instantaneous d _i | | |
| Ref.: n.4 at Evaluation. Report | albond® PE mm based cassette LxH=900x665 mm - Simple folded vertical flanges 45 mm depth with two slots distanced 500 mm each other, tongue width 15 mm on each vertical flange - Complementary folded upper flange - Simple folded bottom flange - Maximum admissible instantaneous deflection: 30 mm - Maximum admissible permanent deflection: 3 mm | 600 | None | 0.02 | 4.64 | | |
| | | 800 | None | 0.04 | 5.93 | | |
| | | 1000 | None | 0.08 | 7.09 | | |
| | | 1200 | None | 0.13 | 8.28 | | |
| | | 1600 | None | 0.51 | 10.62 | | |
| | | 2000 | None | 0.81 | 12.84 | | |
| | | 2200 | None | 1.08 | 14.02 | | |
| | | 2400 | None | 1.32 | 14.48 | | |
| | albond® FR 4 mm based cassette LxH=900x665 mm - Simple folded vertical flanges 45 mm depth with two slots distanced 500 mm each other, tongue width 15 mm on each vertical flange - Complementary folded upper flange - Simple folded bottom flange - Maximum admissible instantaneous deflection: 30 mm - Maximum admissible permanent deflection: 3 mm | 2600 | None | 1.60 | 16.65 | | |
| | | 600 | None | 0.01 | 4.24 | | |
| | | 800 | None | 0.03 | 5.46 | | |
| | | 1000 | None | 0.07 | 6.61 | | |
| | | 1200 | None | 0.13 | 7.78 | | |
| | | 1600 | None | 0.64 | 10.29 | | |
| | | 2000 | None | 0.91 | 12.30 | | |
| | | 2200 | None | 1.18 | 13.35 | | |
| Ref.: n.4 at Ev.Rep | albond® PE 4 mm based cassette LxH=900x1165 mm - Simple folded vertical flanges 45 mm depth with three slots distanced 500 mm each other, tongue width 15 mm on each vertical flange - Complementary folded upper flange - Simple folded bottom flange - Maximum admissible instantaneous deflection: 30 mm - Maximum admissible permanent deflection: 3 mm | 2400 | None | 1.41 | 13.82 | | |
| | | 2600 | None | 1.78 | 15.52 | | |
| | | 600 | None | 0.06 | 9.04 | | |
| | | 800 | None | 0.13 | 11.28 | | |
| | | 1000 | None | 0.19 | 13.27 | | |
| | | 1200 | None | 0.28 | 15.27 | | |
| | | 1600 | None | 0.70 | 18.98 | | |
| | | 2000 | None | 1.10 | 22.52 | | |
| | albond® FR 4 mm based cassette LxH=900x1165 mm - Simple folded vertical flanges 45 mm depth with three slots distanced 500 mm each other, tongue width 15 mm on each vertical flange - Complementary folded upper flange - Simple folded bottom flange - Maximum admissible instantaneous deflection: 30 mm - Maximum admissible permanent deflection: 3 mm - Maximum pull-out resistance of slot: Not declared | 2200 | None | 1.76 | 25.20 | | |
| | | 2400 | Reached max. adm. d _p , d _i | 4.79 | 38.68 | | |
| | | 600 | None | 0.07 | 9.16 | | |
| | | 800 | None | 0.12 | 11.39 | | |
| | | 1000 | None | 0.16 | 13.34 | | |
| | | 1200 | None | 0.22 | 15.24 | | |
| | | 1600 | None | 0.38 | 18.68 | | |
| | | 2000 | None | 0.65 | 22.02 | | |
| Ref.: n.5 at Ev.Rep | albond® PE 4 mm based cassette LxH=900x2165 mm - Simple folded vertical flanges 45 mm depth with five slots distanced 490 mm each other, tongue width 15 mm on each vertical flange - Complementary folded upper flange - Simple folded bottom flange. - Maximum admissible instantaneous deflection: 30 mm - Maximum admissible permanent deflection: 3 mm | 2200 | None | 0.98 | 23.94 | | |
| | | 2400 | None | 1.27 | 25.05 | | |
| | | 2600 | Reached max. adm. d _i | 2.29 | 28.98 | | |
| | | 600 | None | 0.27 | 15.07 | | |
| | | 1200 | None | 0.48 | 25.39 | | |
| | | 1600 | Reached max. adm.d _i | 0.77 | 31.07 | | |
| | | 1800 | Reached max. adm. d _i | 0.98 | 34.23 | | |
| | | albond® FR 4 mm based cassette LxH=900x2165 mm - Simple folded vertical flanges 45 mm depth with five slots distanced 490 mm each other, tongue width 15 mm on each vertical flange - Complementary folded upper flange - Simple folded bottom flange - Maximum admissible instantaneous deflection: 30 mm - Maximum admissible permanent deflection: 3 mm | 600 | None | 0.11 | 14.08 | |
| | 1200 | | None | 0.48 | 24.01 | | |
| | 1600 | | None | 0.63 | 29.23 | | |
| | 1800 | | Reached max. adm. d _i | 0.74 | 31.61 | | |
| | Ref.: n.6 at Ev.Rep | | albond® PE 4 mm based cassette LxH=900x2165 mm - Simple folded vertical flanges 45 mm depth with five slots distanced 490 mm each other, tongue width 15 mm on each vertical flange - Complementary folded upper flange - Simple folded bottom flange - Maximum admissible instantaneous deflection: 30 mm - Maximum admissible permanent deflection: 3 mm | 600 | None | 0.11 | 14.08 |
| | | | | 1200 | None | 0.48 | 24.01 |
| | | | | 1600 | None | 0.63 | 29.23 |
| | | | | 1800 | Reached max. adm. d _i | 0.74 | 31.61 |
| | | albond® FR 4 mm based cassette LxH=900x2165 mm - Simple folded vertical flanges 45 mm depth with five slots distanced 490 mm each other, tongue width 15 mm on each vertical flange - Complementary folded upper flange - Simple folded bottom flange - Maximum admissible instantaneous deflection: 30 mm - Maximum admissible permanent deflection: 3 mm | | 600 | None | 0.11 | 14.08 |
| 1200 | | | | None | 0.48 | 24.01 | |
| 1600 | | | | None | 0.63 | 29.23 | |
| 1800 | | | | Reached max. adm. d _i | 0.74 | 31.61 | |

⁷ Maximum admissible load should be calculated taken into account other criteria if required (e.g. national regulations, etc).

⁸ The following types of failures have been considered: Breakage of any cladding element, failure of fixing, failure of detachment of the frame, and significant permanent deflection. For this last one, it may be considered other than the declared by ETA-holder for ending the test (d_p ≥ 3 mm).

⁹ Deflection values measured at centre of rear side of cladding.

10. Resistance to horizontal point loads:

It has been assessed according to cl. 2.2.10 of EAD on the kit. Results are shown in Table 2.

| Panel type | Deformation (mm) | | | Remarks |
|------------|----------------------|-----------------------------|-------------------------|------------------------------|
| | Initial loaded 500 N | After 1 minute loaded 500 N | After 1 minute unloaded | |
| albond® PE | 0.00 | 8.40 | 0.15 | No reduction of performances |
| albond® FR | 0.00 | 6.60 | 0.00 | No reduction of performances |

11. Impact resistance:

It has been assessed according to cl. 2.2.11 of EAD. Results and use categories obtained are described below in Table 3. In any case, cladding product presented sharp or cutting edges or surfaces able to cause injury to occupants or people nearby.

| Panel Type | Impact | Energy | Ball | Remarks |
|--------------------------|-----------|--------|--------|--|
| albond® PE albond® FR | hard body | 1 J | 0.5 kg | No deterioration (superficial damage without cracking) |
| | | 3 J | 0.5 kg | No deterioration (superficial damage without cracking) |
| | | 10 J | 1.0 kg | No deterioration (superficial damage without cracking) |
| albond® PE albond® FR | soft body | 10 J | 3.0 kg | No deterioration (superficial damage without cracking) |
| | | 60 J | 3.0 kg | No deterioration (superficial damage without cracking) |
| | | 300 J | 50 kg | No deterioration (significant permanent deflection without cracking) |
| | | 400 J | 50 kg | No deterioration (significant permanent deflection without cracking) |
| Use category | | | (I) | A zone readily accessible at ground level to the public and vulnerable to hard body impacts but not subjected to abnormally rough use. |

- Mechanical resistance of the cladding element:

The applicable and/or assessed characteristics are shown at the index below:

12. Bending strength of cladding element (TMCP): See Durability of this ETA.
13. Resistance of the grooved cladding element: Not applicable for family G.
14. Resistance of the cladding element at dowel hole: Not applicable for family G.

- Resistance of the connection between the cladding element and the cladding fixing:

15. Pull through resistance: Not applicable for family G.
16. Pull through resistance under shear loads: Not applicable for family G.
17. Axial resistance: Not applicable for family G.
18. Shear load resistance: Not applicable for family G.
19. Combined tension and shear load resistance: Not applicable for family G.
20. Resistance of slot (family G): See Table 4.

- Mechanical resistance of cladding fixing:

21. Resistance to vertical load: Not applicable for family G.
22. Pull-through resistance of fixings from profile: Not applicable for family G.
23. Resistance of metal clip: Not applicable for family G.

- Mechanical resistance of subframe components:

24. Resistance of profiles: Table 5
25. Tension/pull out resistance of subframe fixings: Table 6
26. Shear resistance of subframe fixings: Table 6
27. Bracket resistance (vertical and horizontal loads): Table 7 and 8

| Type of panel | Pull-out failure load* (N) | | | | | | | Failure |
|-----------------------------|----------------------------|----------------|----------------|----------------|----------------|----------------|------------------|-------------------------------------|
| | F ₁ | F ₂ | F ₃ | F ₄ | F ₅ | F _m | F _{u,5} | |
| ALBOND PE (tongue 15 mm) | 1028,1 | 1064,2 | 1063,6 | 1065,3 | 1064,6 | 1057,2 | 1019,2 | Deformation and breakage of slot |
| ALBOND FR (tongue 15 mm) | 947,7 | 1011,4 | 930,5 | 960,4 | 891,0 | 948,2 | 845,8 | |

* Key: F₁₋₅: Individual values. F_m: Mean value. F_{u,5}: Characteristic value (75% confidence that 95% of test results will be higher than this value)

| Profile ref. | Type | Effective moment of inertia (cm ⁴) | | E modulus (MPa) (EN 1999 1-1) | Alloy EN AW | Mechanical characteristics (minimum) | | | | |
|--------------|--|--|----------------|----------------------------------|---------------|--------------------------------------|--------------------------|-------|-----------------------|-----|
| | | I _x | I _y | | | R _m (MPa) | R _{p 0,2} (MPa) | A (%) | A _{50mm} (%) | HBW |
| 02.01.004 | Extruded Ω-shape Wing thickness ≥2 mm | 16,8 | 6,5 | 70000 | 6063 T5/T6 | ≥ 160 | ≥ 120 | ≥ 8 | ≥ 6 | 60 |

| Kit (components) | Type of fixing (example) | Dimensions [d x L] mm | Mechanical properties (characteristic values) (Source: Supplier Technical sheet) |
|--|--|-----------------------|---|
| Albond SC Hanger ref. 02.01.003 and cassette to vertical profile Ω- shape ref.02.01.004 | Self-drilling and self-tapping screws EN ISO 15480 or 15481 ⁽¹¹⁾ (also known as DIN 7504 N or K) ⁽¹²⁾ ST 4.8 x 19 mm A2/50 stainless steel A2 | 4.8 x 19 | - Pull out load (F _u): 0.95 kN (thickness 2.0 mm) - Tensile breaking load Z _b (F _u): 7,11 kN - Shear breaking load Q _b (F _u): 3,56 kN |
| Albond SC Bracket U ref. 01.01.006 to Ω vertical profile ref. 02.01.004 | Self-screwing screw made of stainless steel A2: Hexagon washer head drilling screws with tapping screw thread EN ISO 15480 (also known as DIN 7504 K) plus complementary EPDM washer if needed (5,5 x 19). | 5,5 x 19 | - Pull out load (F _u): ≥ 0.95 kN (thickness 2.0 mm) - Tensile breaking load Z _b (F _u): ≥ 7,11 kN - Shear breaking load Q _b (F _u): ≥ 3,56 kN |

| BRACKET | Results | | | | | Remarks |
|---------------|--------------------------------|---------------------------------|--------------------------------|---------------------------------|---------------------------------|---------|
| | F _m (daN) ΔL=1mm | F _{1d} (daN) ΔL=1mm | F _m (daN) ΔL=3mm | F _{1d} (daN) ΔL=3mm | F _s (daN) failure | |
| Ref.02.01.001 | 75.5 | 59.0 | 216 | 73.6 | No breakage. Purposeless | U shape |

| BRACKET | Results | | | Remarks |
|---------------|--------------------------------|---------------------------------|---------------------------------|---------|
| | F _m (daN) ΔL=1mm | F _{1d} (daN) ΔL=1mm | F _s (daN) failure | |
| Ref.02.01.001 | 257,7 | 103,1 | No breakage. Purposeless | U shape |

- **Basic Work Requirement 5: Protection against noise**

28. Airborne sound insulation:

No performance assessed according to cl. 2.2.13 of EAD.

- **Basic Work Requirement 6: Energy economy and heat retention**

29. Thermal resistance:

Not relevant as the cladding kit does not include the thermal insulation according to cl. 2.2.14 of EAD.

¹⁰ EN 755-2:2016: Aluminium and aluminium alloys - Extruded rod/bar, tube and profiles - Part 2: Mechanical properties.

¹¹ EN ISO 15480:2019 Hexagon washer head drilling screws with tapping screw thread (ISO 15480:2013).

EN ISO 15481:1999. Cross recessed pan head drilling screws with tapping screw head (ISO 15481:1999).

¹² DIN 7504 German national standard not valid.

- **Durability**

According to cl. 2.2.15 of EAD, which considers cl. 2.2.15.9 when cladding kits are based on TMCP, the assessment of durability is addressed to applicable characteristics 38 to 55 as described below:

- 30. Hygrothermal behaviour of the kit: Not relevant for the assessed kit.
- 31. Behaviour after pulsating loads: See applicable characteristics from J.49 to J.50
- 32. Freeze-thaw resistance: See applicable characteristics from J.38 to J.55
- 33. Behaviour after immersion in water: See applicable characteristics from J.38 to J.55
- 34. Dimension stability: Not relevant for the assessed kit.
- 35. Chemical and biological resistance: Not relevant for the assessed kit.
- 36. UV and radiation resistance: See applicable characteristics from J.38 to J.55.
- 37. Corrosion. Resistance of substructure:

| Table 9: Corrosion resistance of subframe components made of aluminium profiles | | | | |
|---|-------------------|-------------|--------------|---|
| Kit | Type | Alloy EN AW | Protection | Corrosion resistance (Eurocode 9) ⁽¹³⁾ |
| Aluminium profiles | Vertical profiles | 6063 T5/T6 | Raw finished | Durability rating: B |
| | Bracket | 6063 T5/T6 | Raw finished | Durability rating: B |

According to ch. 4 Durability of Eurocode 9, under normal atmospheric conditions (e.g. rural, moderate industrial or urban areas), aluminium alloys profiles as listed above can be used without the need for surface protection to avoid loss of bearing capacity. In severe environments, especially those with a high chloride content, attention must be paid to the risk of galvanic corrosion. Some form of insulation between aluminium and more noble metals (e.g. carbon steel, stainless steel, copper) is recommended.

- 38. Decay of delamination resistance after hygrothermal cycles:

| Table 10: Decay of resistance | | | | |
|-------------------------------|-------------------------|-------------------------------------|-----------------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | | Remarks |
| albond® PE albond® FR | Delamination resistance | Front sheet: > 75% Initial value | Rear sheet > 75% Initial value | No cracks, or breakage |

- 39. Decay of delamination resistance after immersion in boiling water 6 h at 90° C:

| Table 11: Decay of resistance | | | | |
|-------------------------------|-------------------------|-------------------------------------|-----------------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | | Remarks |
| albond® PE albond® FR | Delamination resistance | Front sheet: > 75% Initial value | Rear sheet > 75% Initial value | No cracks, or breakage |

- 40. Decay of delamination resistance after immersion in water 500 h at 20° C:

| Table 12: Decay of resistance | | | | |
|-------------------------------|-------------------------|-------------------------------------|-----------------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | | Remarks |
| albond® PE albond® FR | Delamination resistance | Front sheet: > 75% Initial value | Rear sheet > 75% Initial value | No cracks, or breakage |

- 41. Decay of delamination resistance after freeze-thaw cycles:

| Table 13: Decay of resistance | | | | |
|-------------------------------|-------------------------|-------------------------------------|-----------------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | | Remarks |
| albond® PE albond® FR | Delamination resistance | Front sheet: > 75% Initial value | Rear sheet > 75% Initial value | No cracks, or breakage |

¹³ Eurocode 9: EN 1999-1-1:2007+A1:2009 Design of aluminium structures. General structural rules. Annex C. Table.C.1. and Table 3.1

42. Decay of delamination resistance after long term exposure to heat (2500 h at hot dry air 80 °C)*:

| Table 14: Decay of resistance | | | | |
|-------------------------------|-------------------------|-------------------------------------|-----------------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | | Remarks |
| albond® PE albond® FR | Delamination resistance | Front sheet: > 75% Initial value | Rear sheet > 75% Initial value | No cracks, or breakage |

43. Decay of flexural resistance after hygrothermal cycles*:

| Table 15: Decay of resistance | | | |
|--|---------------------|-------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | Remarks |
| albond® PE | Flexural resistance | > 75% Initial value | No cracks, or breakage |
| * Characteristics not applicable to panel albond® FR | | | |

44. Decay of flexural resistance after immersion in boiling water 6 h at 90 °C*:

| Table 16: Decay of resistance | | | |
|--|---------------------|-------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | Remarks |
| albond® PE | Flexural resistance | > 75% Initial value | No cracks, or breakage |
| * Characteristics not applicable to panel albond® FR | | | |

45. Decay of flexural resistance after immersion in water 500 h at 20 °C:

| Table 17: Decay of resistance | | | |
|--|---------------------|-------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | Remarks |
| albond® PE | Flexural resistance | > 75% Initial value | No cracks, or breakage |
| * Characteristics not applicable to panel albond® FR | | | |

46. Decay of flexural resistance after freeze-thaw cycles:

| Table 18: Decay of resistance | | | |
|--|---------------------|-------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | Remarks |
| albond® PE | Flexural resistance | > 75% Initial value | No cracks, or breakage |
| * Characteristics not applicable to panel albond® FR | | | |

47. Decay of flexural resistance after long term exposure to heat (2500 h at hot dry air 80 °C):

| Table 19: Decay of resistance | | | |
|--|---------------------|-------------------------|------------------------|
| Sample | Characteristic | Mean value after ageing | Remarks |
| albond® PE | Flexural resistance | > 75% Initial value | No cracks, or breakage |
| * Characteristics not applicable to panel albond® FR | | | |

48. Decay of flexural stiffness:

| Table 20: Decay of flexural stiffness | | | |
|---------------------------------------|--|-------------------------------|------------------------|
| Sample | Characteristic | $d_{80 ME} (1 h 80^{\circ}C)$ | Remarks |
| albond® PE albond® FR | Increase of deflection after 1 h 80 °C | $\leq 1,25 d_{20 ME}$ | No cracks, or breakage |

49. Decay of resistance to routed and returned edge after TPB test flexural, pulsating loads:

| Table 21: Decay of resistance to flexural pulsating loads | | | |
|---|---|-------------------------------------|-------------------------------------|
| Sample | Characteristic | Load (N) | Remarks |
| | | Aged characteristic force $F_{u,5}$ | |
| albond® PE albond® FR | TPB test Flexural pulsating loads cycles | > 75% Initial value | No cracks, breakage or delamination |

50. Decay of resistance to slot and its fixing devices after pulsating loads:

| Table 22: Decay of Pull out resistance | | | | |
|--|--------------------|-------------------------------------|--|-------------------------------------|
| Sample | Characteristic | Load (N) | | Remarks |
| | | Aged characteristic force $F_{u,5}$ | | |
| albond® PE albond® FR | Pulsating loads | > 75% Initial value | | No cracks, breakage or delamination |
| | Freeze Thaw cycles | | | |
| | Water immersion | | | |

51. Corrosion infiltration after exposure to spray salt:

| Table 23: Corrosion resistance (infiltration) of cladding element made of coil coated aluminium | | | |
|---|------------------------|---------------------------------|--|
| Sample | Characteristic | Defects | Remarks |
| PVDF lacquered aluminium sheet | Corrosion infiltration | No defects after 500 and 1000 h | Index 3 according to EN 1396 ⁽¹⁴⁾ |

52. Degree of blistering after exposure to humidity:

| Table 24: Corrosion resistance (blistering) of cladding element made of coil coated aluminium | | | |
|---|----------------|---------------------------------|--|
| Sample | Characteristic | Defects | Remarks |
| PVDF lacquered aluminium sheet | Blistering | No defects after 500 and 1000 h | Index 3 according to EN 1396 ⁽¹⁴⁾ |

53. Retention of bright and colour:

| Table 25: Retention of bright and colour | | | | | |
|--|-------------------------|---|---|---|--------------------|
| Characteristic | Commercial ref. | Humidity | UVB & water 1500 h | Heat | Remarks |
| Retention of bright (gloss units) | Blue Silver metallic | Gloss _{AGED} ≥ 0.8 Gloss _{INI} | Gloss _{AGED} ≥ 0.8 Gloss _{INI} | Gloss _{AGED} ≥ 0.8 Gloss _{INI} | OK |
| Retention of colour ΔE | Blue Silver metallic | OK -- | OK -- | OK -- | OK Not required |

¹⁴ EN 1396:2015. Aluminium and aluminium alloys. Coil coated sheet and strip for general applications. Specifications

4. Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

4.1 System of assessment and verification of constancy of performances

According to the decision 2003/640/EC of the European Commission ⁽¹⁵⁾ the system of assessment and verification of constancy of performances (see Annex V to Regulation (EU) No 305/2011) given in the following Table applies:

| Product(s) | Intended use(s) | Level(s) or class (es) | System (s) |
|-------------------------|-------------------------|-------------------------------|-------------------|
| Kit based on albond® PE | External wall claddings | All / any | 2+ |
| Kit based on albond® FR | External wall claddings | All / any | 1 |

5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

The ETA is issued for the kit on the basis of agreed data / information which identify the products that have been assessed and judged. Detailed description and conditions of the manufacturing process of the kit, and all the relevant design and installation criteria of the kit are specified in the manufacturer's technical documentation deposited with the IETcc. It is the manufacturer's responsibility to make sure that all those who use the kit is appropriately informed of specific conditions according to sections 1-5.



Instituto de Ciencias de la Construcción Eduardo Torroja
CONSEJO SUPERIOR DE INVESTIGACIONES CIENTÍFICAS

c/ Serrano Galvache n. 4. 28033 Madrid.
Tel.: (+34) 91 302 04 40
<https://dit.ietcc.csic.es>



On behalf of the Instituto de Ciencias de la Construcción Eduardo Torroja
Madrid, 4th August 2021



Director IETcc-CSIC

¹⁵ Published in the Official Journal of the European Union (OJEU) L226/21 of 10.09.2003. See www.new.eur-lex.europa.eu/oj/direct-access.html

Annex A: General Schemes

Remark: check www.albond.com.tr for further information

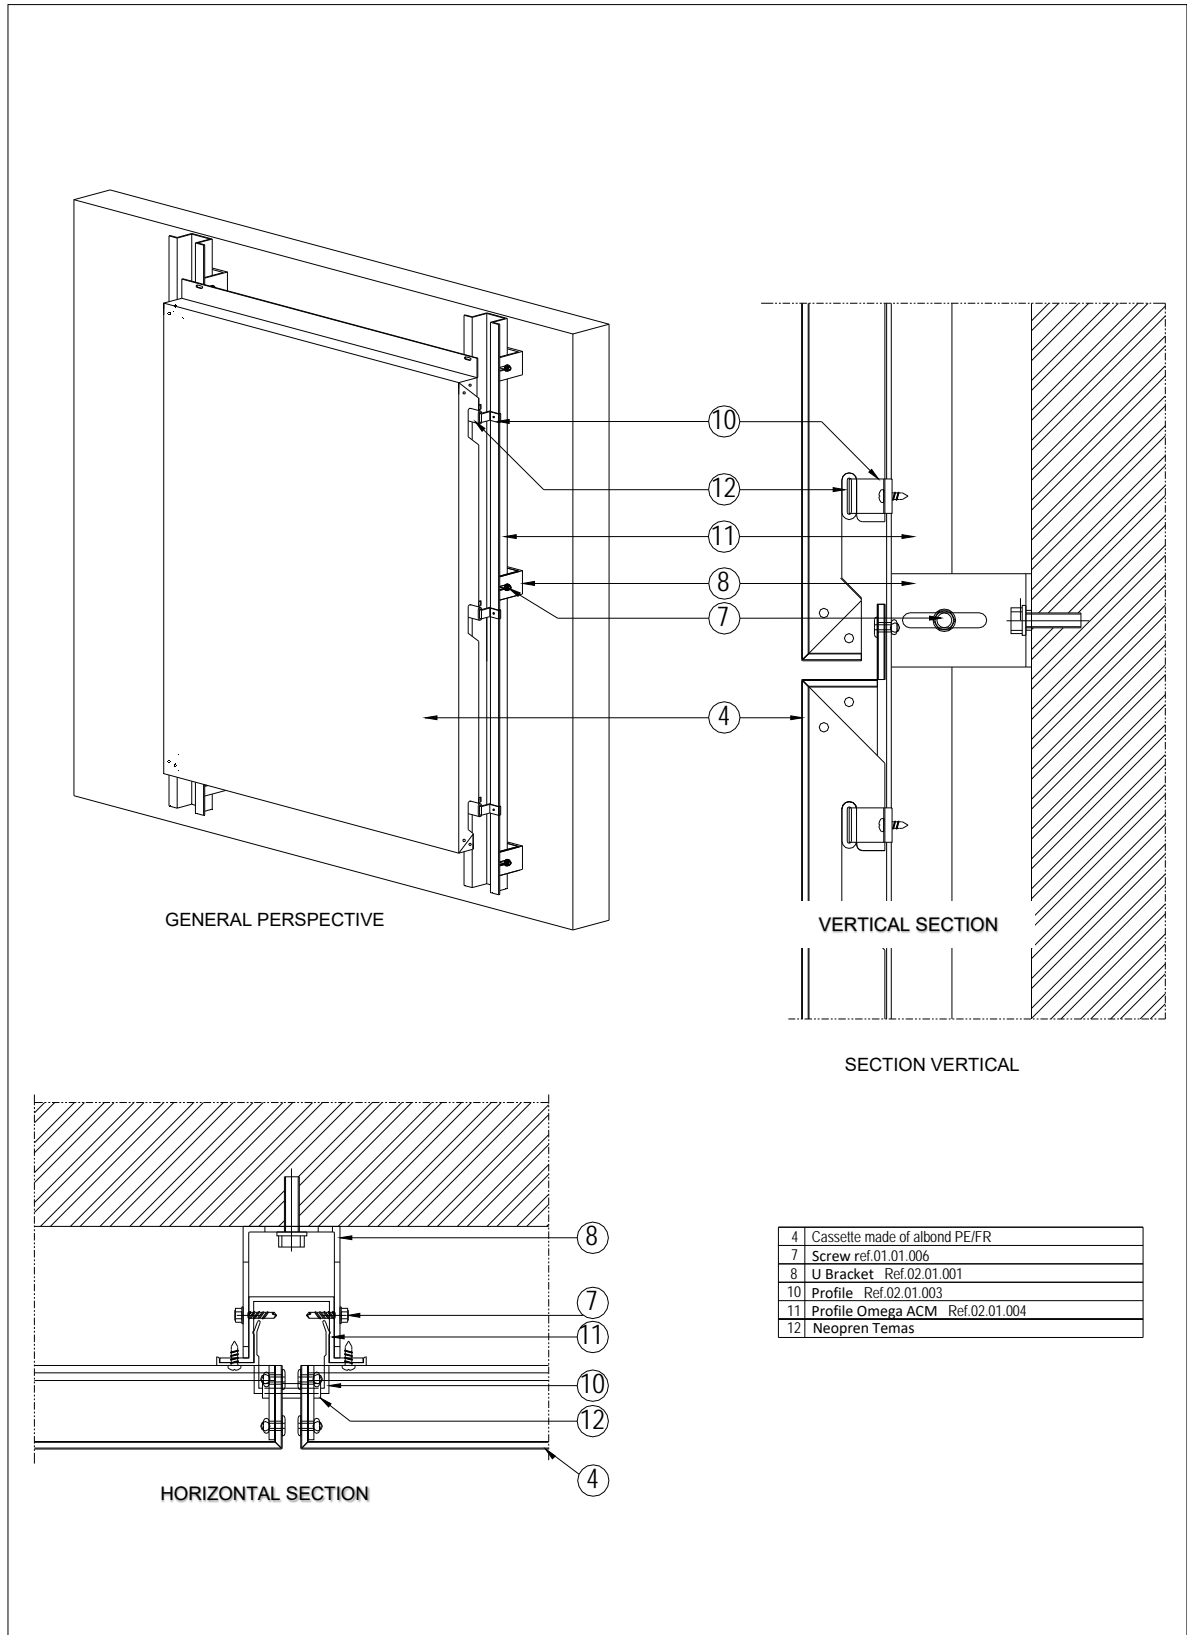


Figure 1. Example of ALBOND SC cladding kit

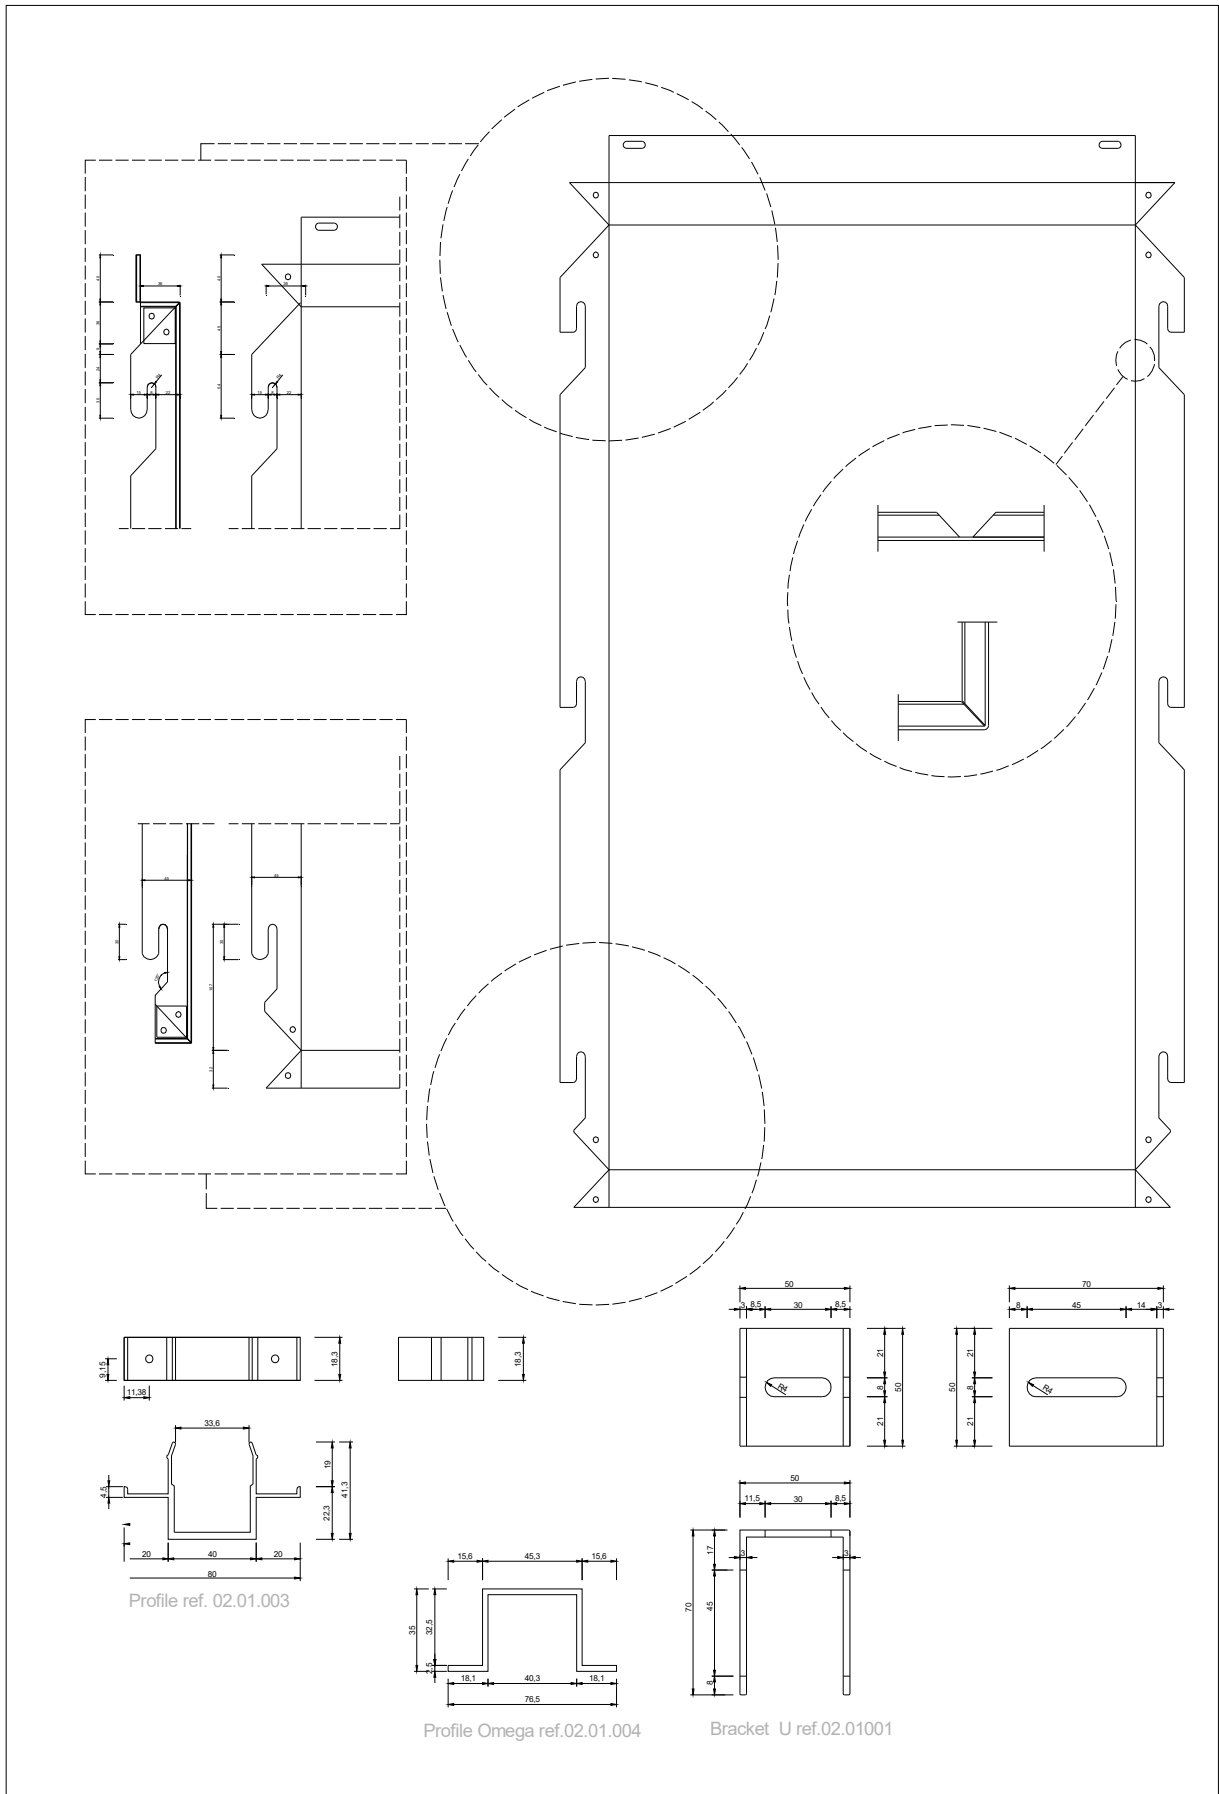


Figure 2. Details of cassette formation (above) and details of main subframe components (below)

Annex B: Complementary physical and mechanical data of cladding kit elements

| Panel | Material | Characteristics | Value | |
|--------------------------------|--|--|--|------|
| albond® PE albond® FR | Removable protection film | Aspect: | White | |
| | Coating layer (PVDF) | By-layer | Thickness (µm) | ≥ 22 |
| | | Multilayer | Thickness (µm) | ≥ 35 |
| | External sheet of alloyed aluminium EN AW 3005 H42/H44 or 3105 H42/H44/H46 or 5005 H42/H44 (painted) | E Modulus (MPa) Thickness (mm): Linear thermal expansion coefficient (K ⁻¹): | 70 000 0.50 [± 0.02] 24 x 10 ⁻⁶ | |
| | Full core made of low density recycled polyethylene (albond® PE) | Aspect: Thickness (mm): | Black 3.0 | |
| | Core of low density recycled polyethylene and mineral compounds (albond® FR) | Aspect: Thickness (mm): | Grey 3.0 | |
| | Rear sheet of alloyed aluminium EN AW 3005 H42/H44 or 3105 H42/H44/H46 or 5005 H42/H44 (painted) | E Modulus (MPa) Thickness (mm): Linear thermal expansion coefficient (K ⁻¹): | 70 000 0.50 [± 0.02] 24 x 10 ⁻⁶ | |
| | Protective coating layer | Thickness (µm): | Confidential (Annex C) | |

| Panel | Material | Characteristic | Value |
|---|--|---|-------|
| albond® PE albond® FR | Alloyed aluminium sheet EN AW 3105 H44 | Tensile strength R _m (MPa) | ≥ 150 |
| | | Yield strength R _{p 0,2} (MPa) | ≥ 120 |
| | | Elongation A ₅₀ (%) | ≥ 3 |
| | Alloyed aluminium sheet EN AW 3105 H46 | Tensile strength R _m (MPa) | ≥ 175 |
| | | Yield strength R _{p 0,2} (MPa) | ≥ 150 |
| | | Elongation A ₅₀ (%) | ≥ 2 |
| | Alloyed aluminium sheet EN AW 5005 H44 | Tensile strength R _m (MPa) | ≥ 145 |
| | | Yield strength R _{p 0,2} (MPa) | ≥ 110 |
| | | Elongation A ₅₀ (%) | ≥ 2 |
| | Alloyed aluminium sheet EN AW 5005 H46 | Tensile strength R _m (MPa) | ≥ 165 |
| | | Yield strength R _{p 0,2} (MPa) | ≥ 135 |
| | | Elongation A ₅₀ (%) | ≥ 2 |
| Peeling resistance between sheet (external or rear) and core (N.mm/mm) ASTM D 913 | | | ≥ 7.0 |

Annex C: Confidential information

This confidential information and is not included in the European Technical Assessment when that assessment is publicly available: C.1. Quality control of components of the kit manufactured by suppliers or ETA holder.